



Test Report

No. A/JD2805113

Date: JUN.05,2008

Page 1 of 2

The following sample(s) was/were submitted and identified on behalf of the client as:

Product Description: PVC COATED FABRIC

We have tested the submitted sample(s) as requested and the following results were obtained:

Test Required:

Perform the following test items:

DIN 4102-1:1990 Fire Behavior of Building Materials and Elements - Classification of Building Materials - Requirements and Testing.

Test Results: -- See attached sheet --

Conclusion: According to the Criteria for Classification in DIN4102-1, the test Sample Met the Requirement of B1 Classification.

Test Duration:

Sample Receiving Date : MAY.15,2008

Test Performing Date : MAY.15,2008 TO JUN.06, 2008

Signed for and on behalf of
SGS-CSTC Co., Ltd.


Winsong Weng
Supervisor

This Test Report is issued by the Company subject to its General Conditions of Service printed overleaf or attached. Such Conditions are also available upon request or are accessible at www.sgs.com. Attention is drawn to the limitations of liability, indemnification and jurisdictional policies defined therein. The results shown in this Test Report refer only to the sample(s) tested, unless otherwise stated and such sample(s) are retained for your use only. This Test Report shall not be reproduced except in full, without written approval of the Company.



SGS-CSTC (China) Co., Ltd. | No. 3898 Huaihai Road, Pudong District, Shanghai, China | 313200 | 186-572-501825 | 186-572-501825 | www.cn.sgs.com
中国·浙江·安吉县康工业功能区康桥路2号 | 邮编: 313200 | 186-572-501825 | 186-572-501825 | sgs.china@sgs.com

AJHG 107514

Member of the SGS Group (SGS SA)

Test Conducted: Based On DIN 4102-1:1998 Fire Behavior of Building Materials and Elements - Classification of Building Materials - Requirements and Testing


General Information

Sample Description	PVC Coated Fabric
Thickness	0.5 mm
Size	16pcs of 1000mmX190mmX0.5mm; 5pcs of 190mmX90mmX0.5mm;

Test Results:

Test Items	Parameter	Result	Conclusion
The minimum residual lengths (mm)	>0	343	PASS
Average residual lengths (mm)	≥150	356	PASS
The mean effluent temperature(°C)	≤200	177	PASS
The greatest flame height (mm)	<150	39	PASS
The smoke density value	≤75	27	PASS

Photo Appendix:

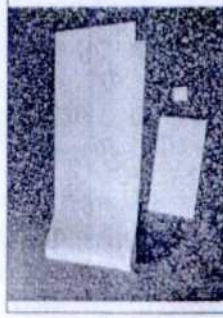

End of Report



This Test Report is issued by the Company subject to its General Conditions of Service printed overleaf or attached. Said Conditions are also available upon request or are accessible at www.sgs.com. Attention is drawn to the limitations of liability, indemnification and jurisdictional policies stated therein. The results shown in this Test Report refer only to the sample(s) tested unless otherwise stated and such sample(s) are retained for one day after the date of this Test Report shall not be reproduced except in full, without written approval of the Company.

SGS (Société Générale de Surveillance) S.A. | No.2 Hong Kong Road, Canton, China, P.R. | 313200 | 中国·浙江·安吉县龙溪工业园区德林路2号 | 邮编: 313200 | 电话: 86-571-5019825 | 1 86-571-5019825 | 1 86-571-5019825 | www.cn.sgs.com | sgs.china@sgs.com

AJHG 107615

Member of the SGS Group (SGS SA)